

[illegible]

115V, 1 $\phi$ , 60HZ

INDUCTION UNIT SCHEDULE				
TYPE NO.	CFM	COOLING BTU'S	HEATING BTU'S	SECONDARY WATER GPM
GT	90	6450	7560	1.50

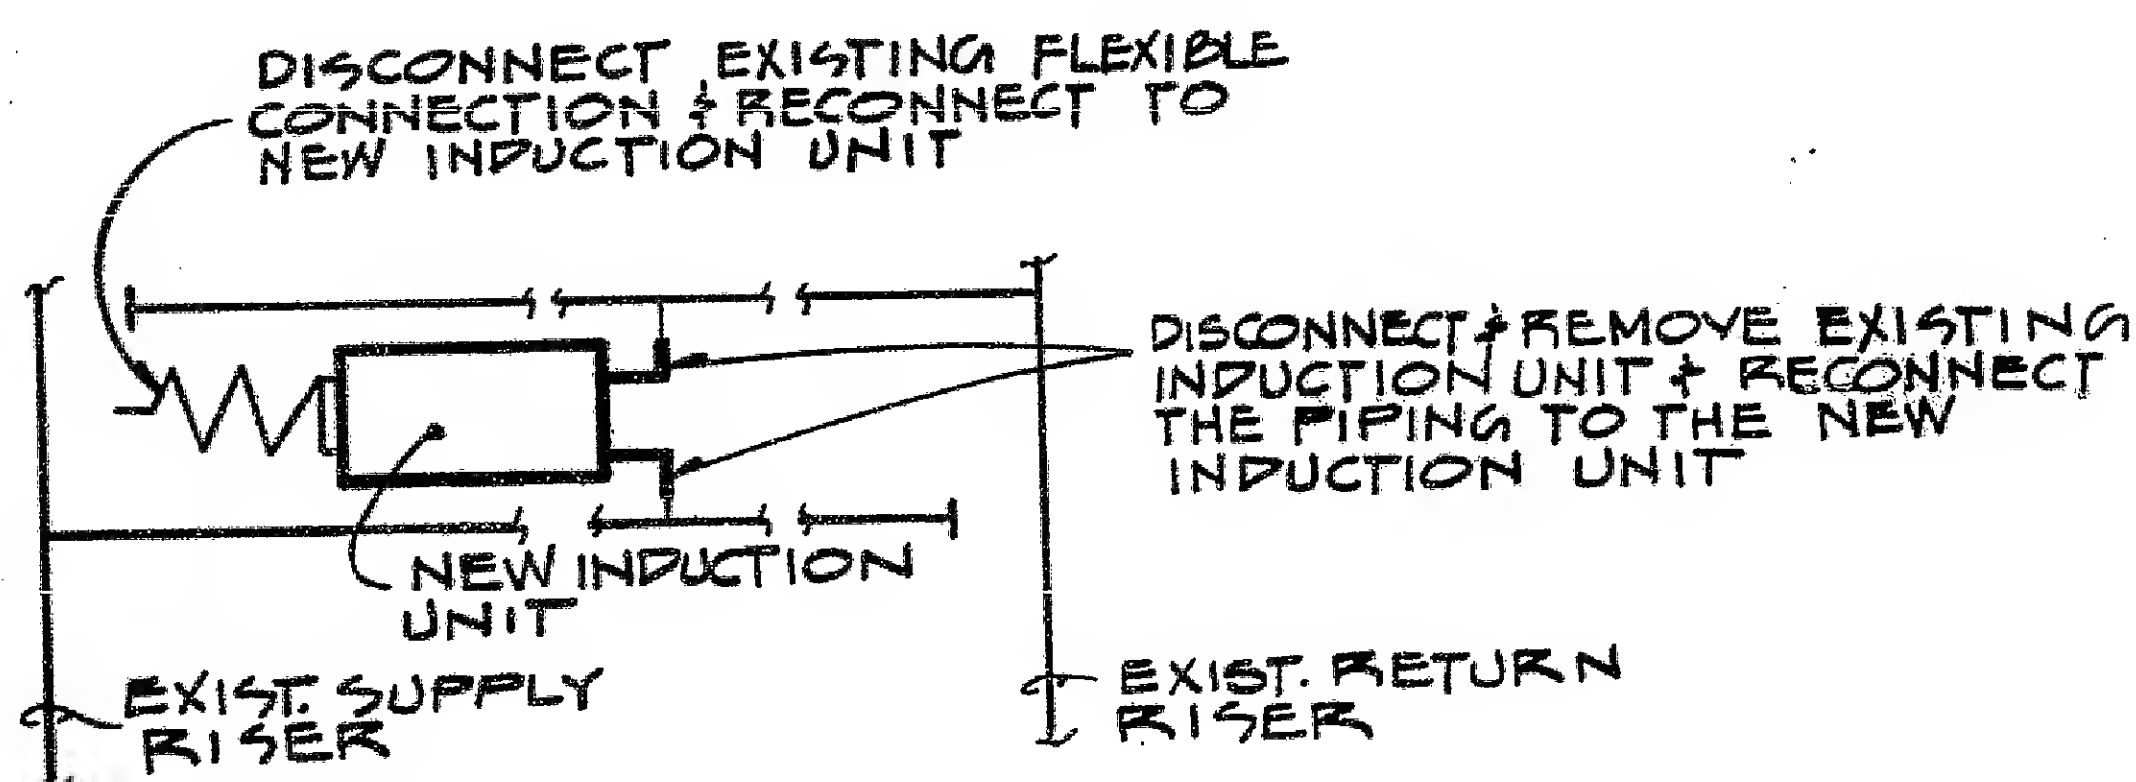

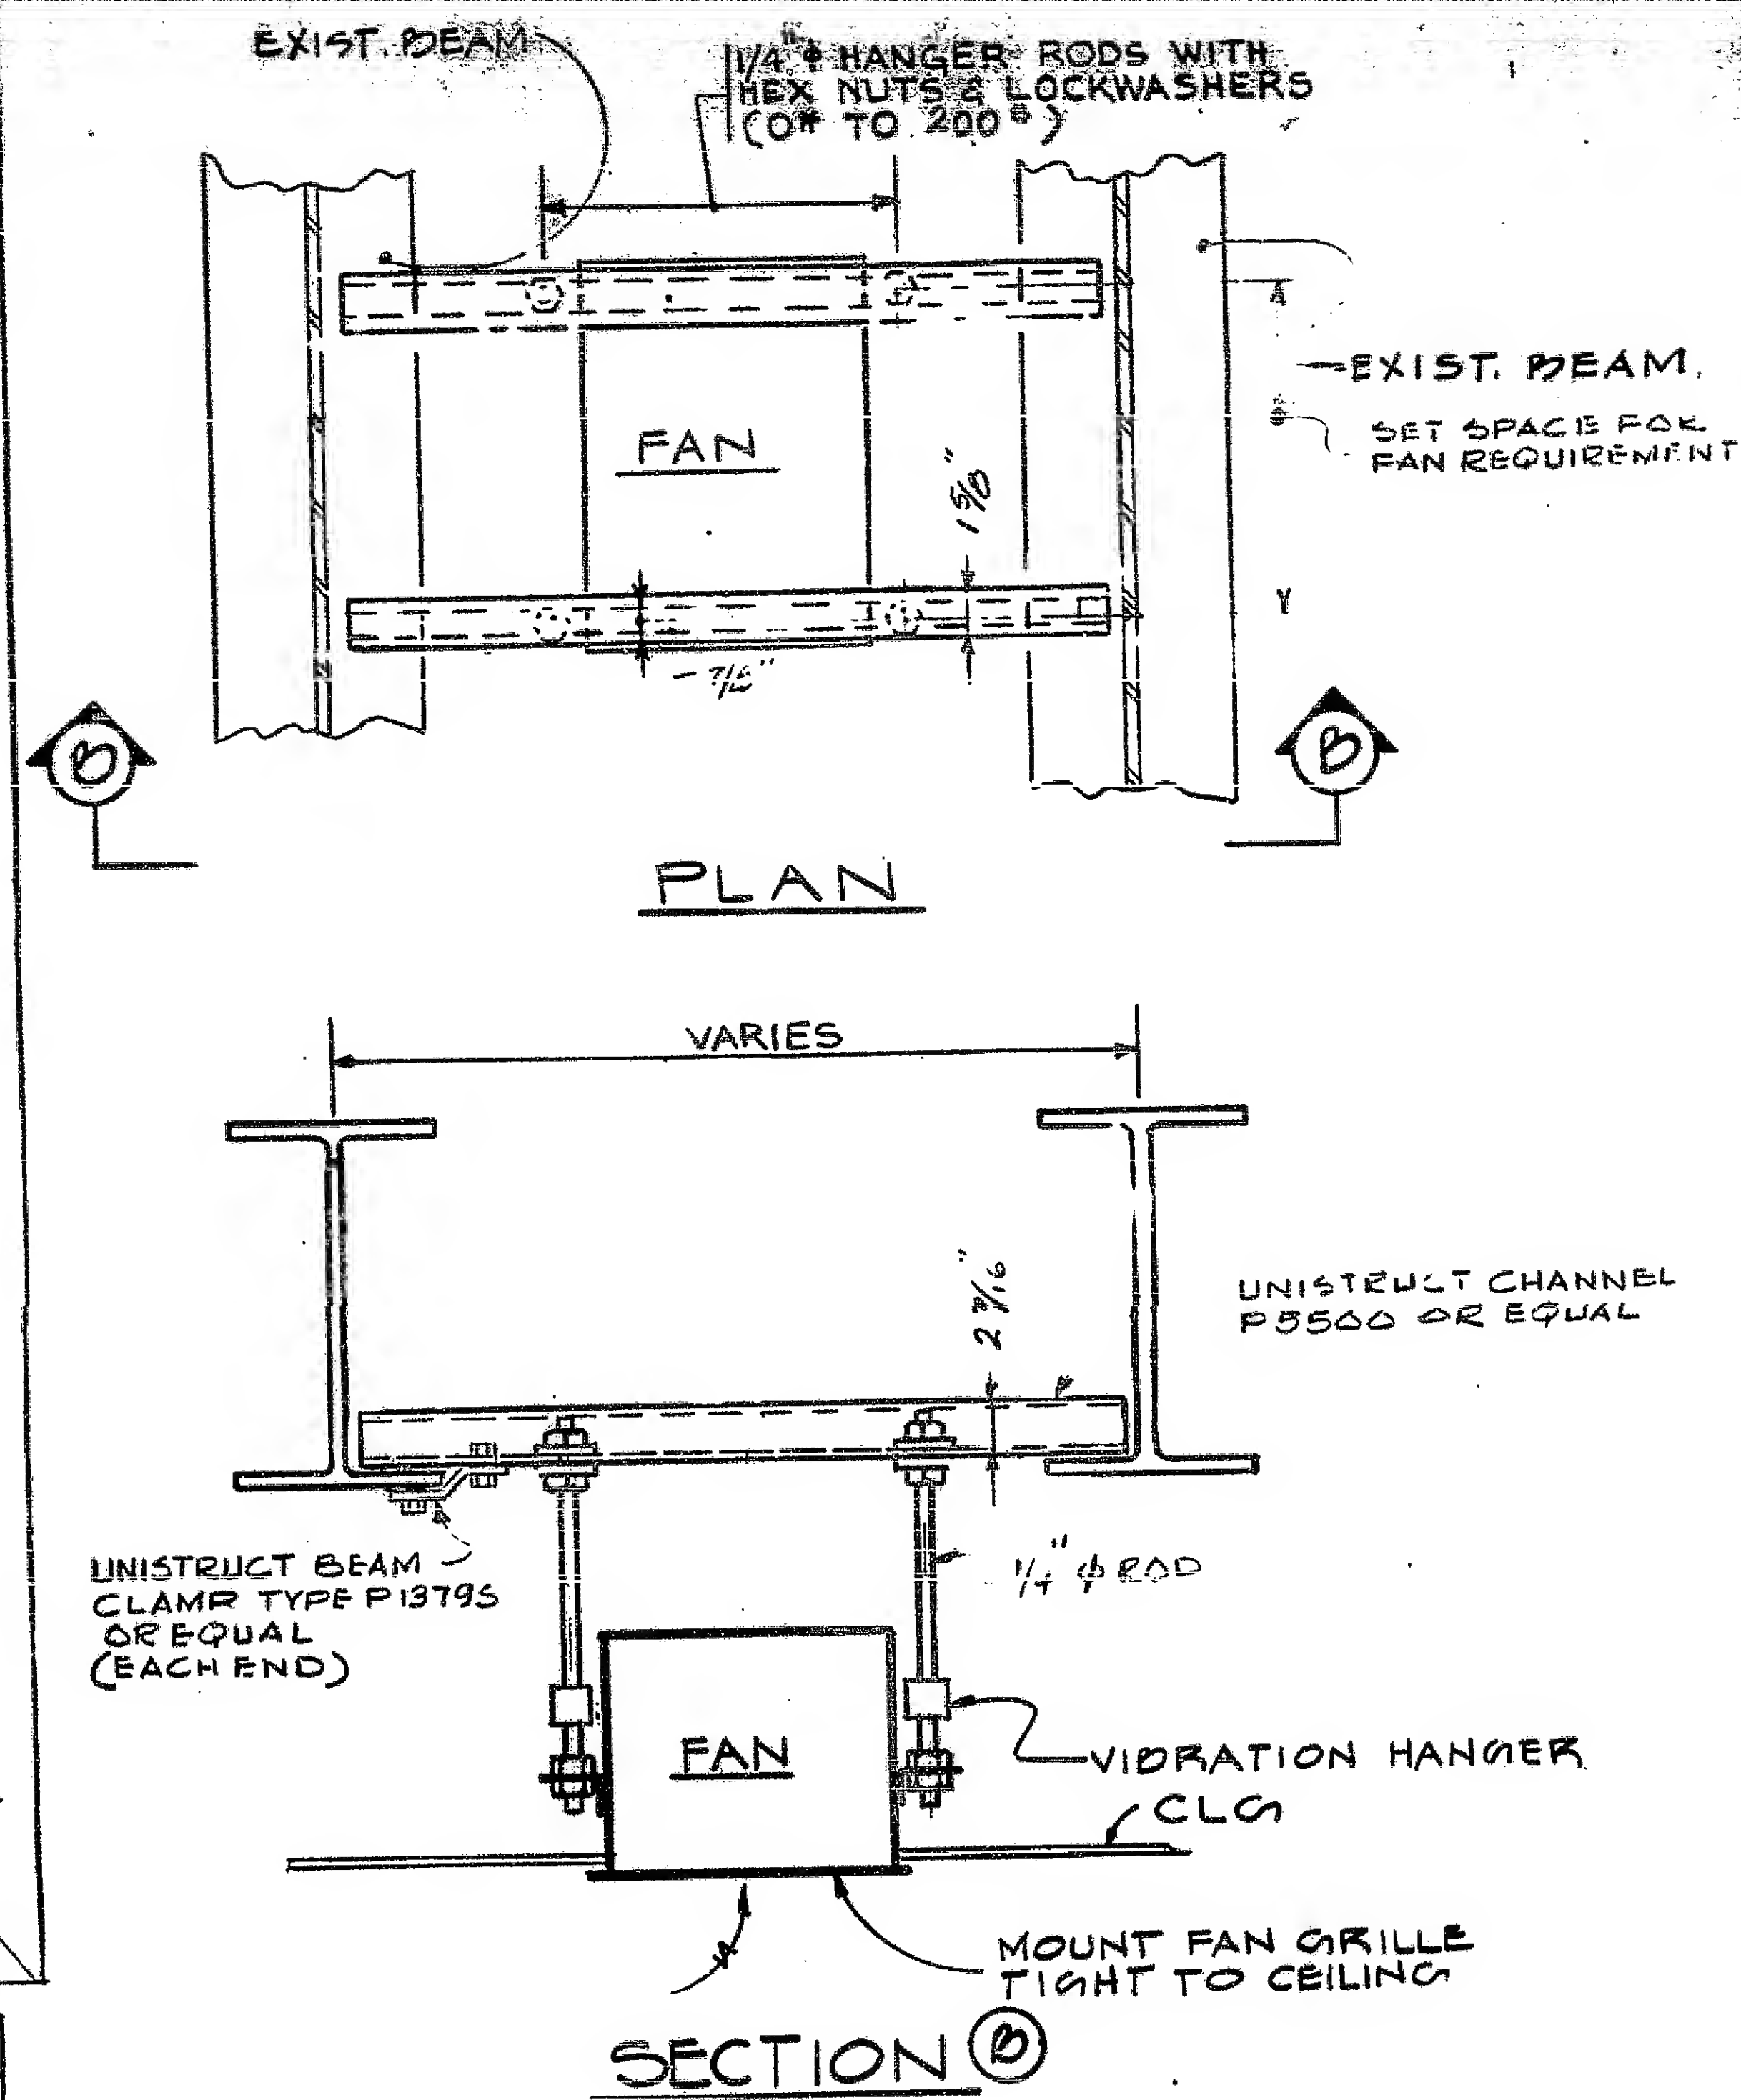


SCHEMATIC PIPING CONNECTIONS  
TO NEW INDUCTION UNITS  
NOMINAL COPPER PIPE SIZES  
NO SCALE



### TYPICAL FAN HANGER DETAIL

C15 / BN				REVISIONS				
DESIGNED	NO.	DATE	APPD.	DESCRIPTION	NO.	DATE	APPD.	DESCRIPTION
C17								
DRAWN								
BN								
CHECKED								
AD								
IN CHARGE								

 E. J. Smith ASST. CHIEF ENGINEER OF DESIGN + RESEARCH	 H. W. [unclear] ENGINEER AIRFO
 N. L. [unclear] CHIEF MECHANICAL ENGINEER	FEB. DATE